


FAST-STAT Installation Guide C

(read Installation Guide A & B first for basic instructions)

Using two Model 3000's on one system

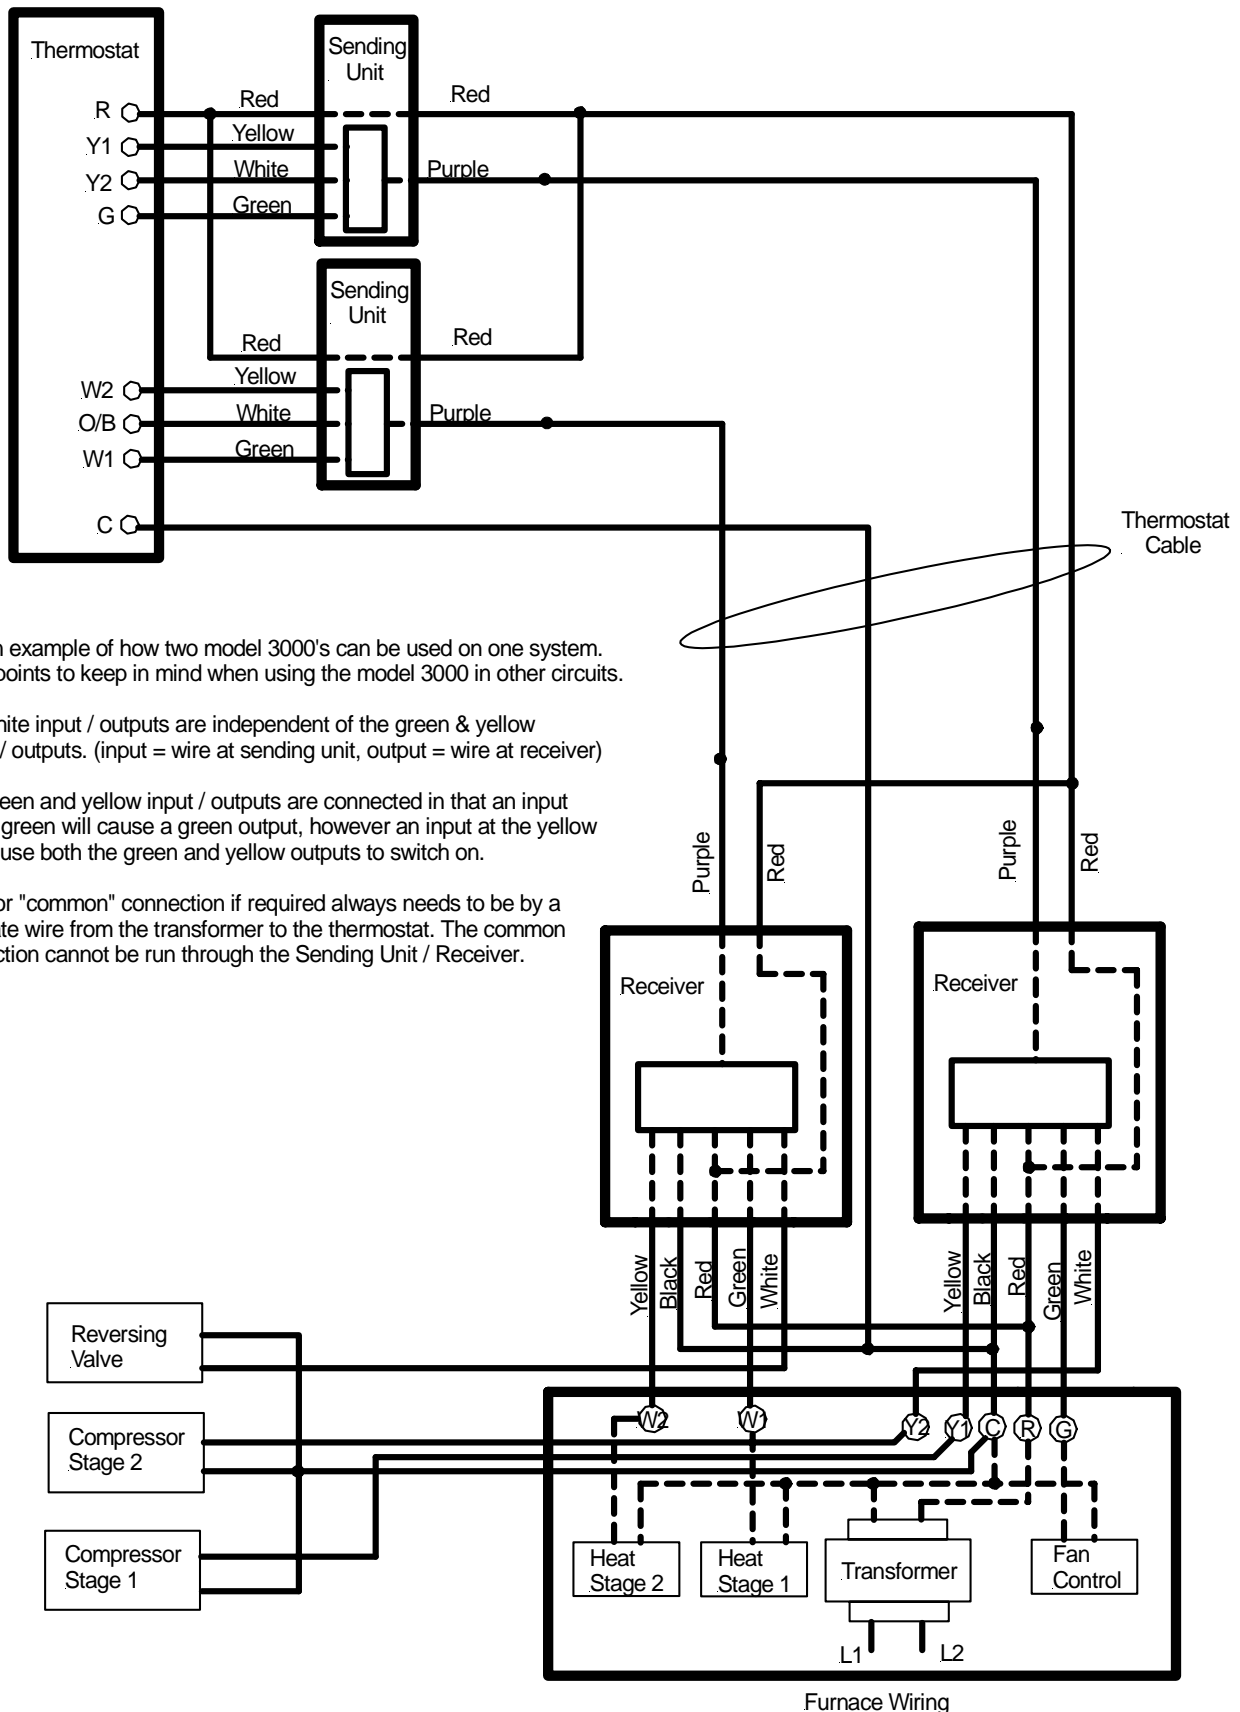

Notes:

This is an example of how two model 3000's can be used on one system. The key points to keep in mind when using the model 3000 in other circuits.

- 1) The white input / outputs are independent of the green & yellow input / outputs. (input = wire at sending unit, output = wire at receiver)
- 2) The green and yellow input / outputs are connected in that an input at the green will cause a green output, however an input at the yellow will cause both the green and yellow outputs to switch on.
- 3) A "C" or "common" connection if required always needs to be by a separate wire from the transformer to the thermostat. The common connection cannot be run through the Sending Unit / Receiver.